


Druck/  
Pressure **P**



CU  
USER  
DEF


MA  
USER  
DEF

**STANDARD-  
EXTRACTION**

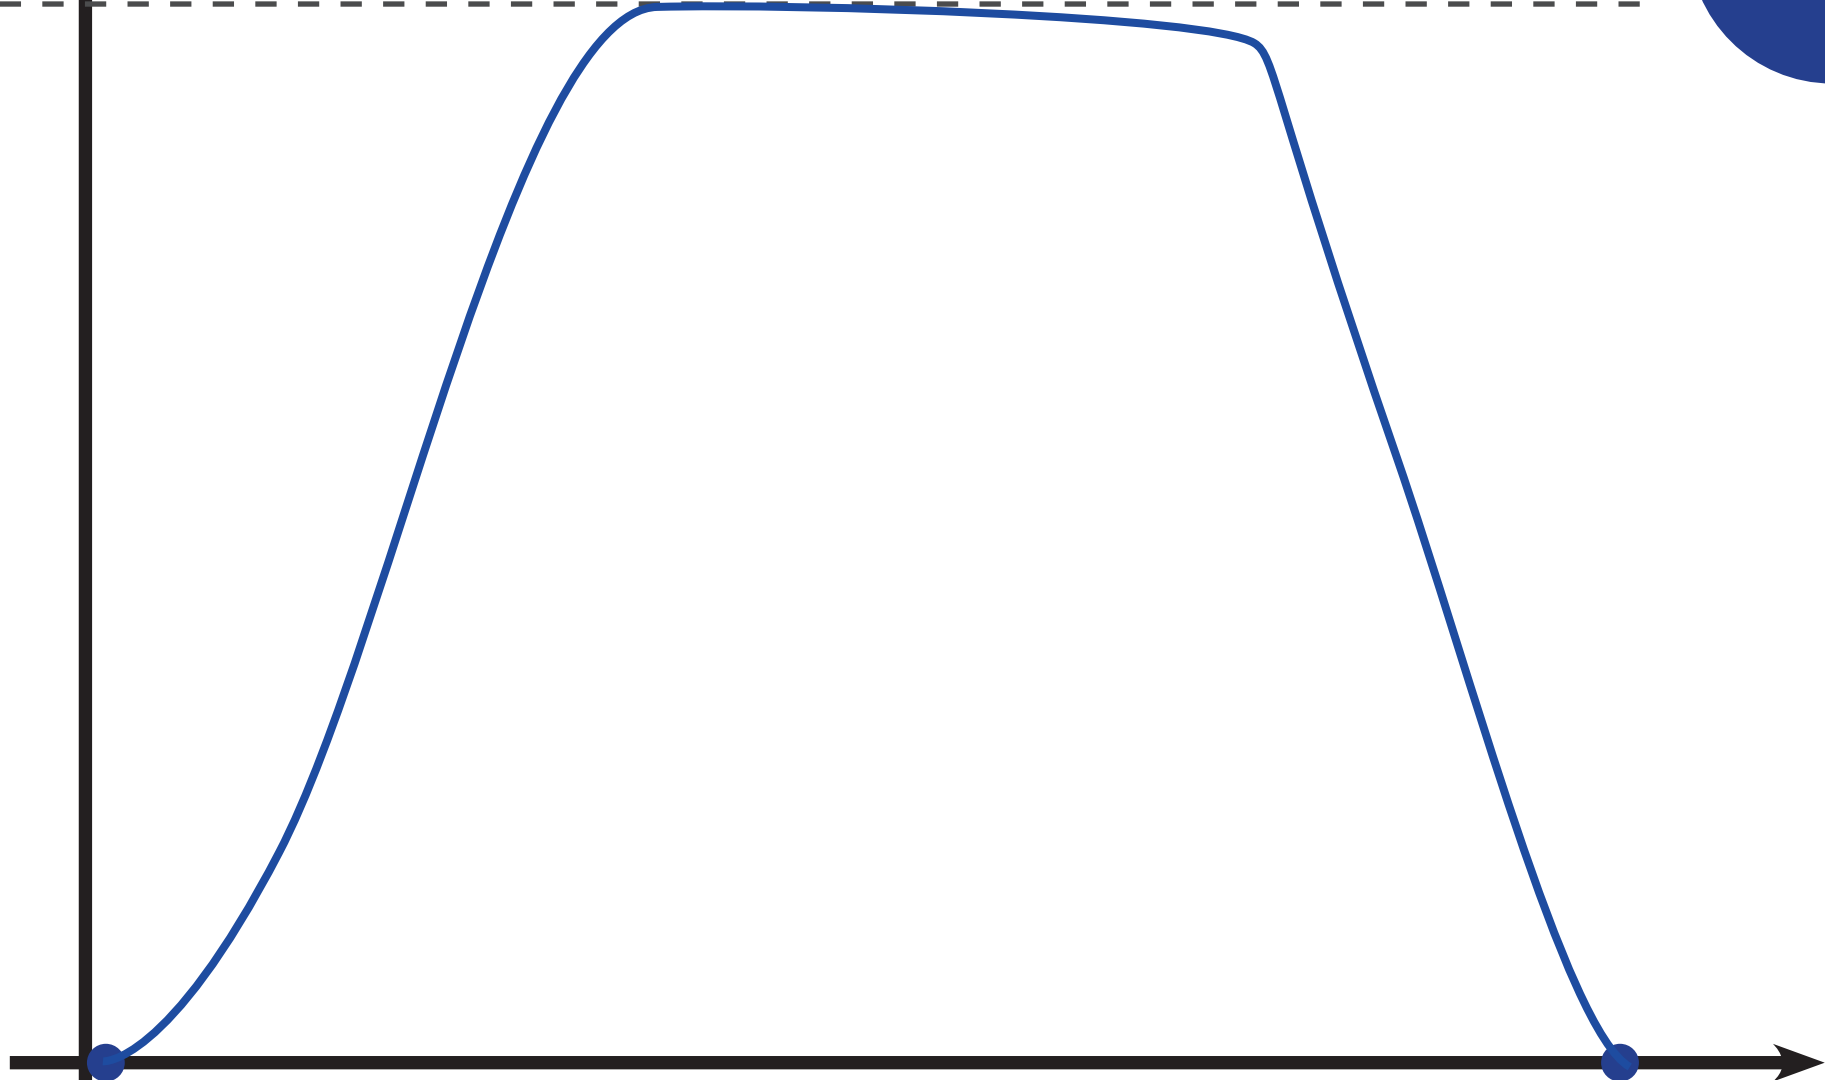

keine/no Pre-Infusion

**T** Extraktions-Zeit/  
Brewing time

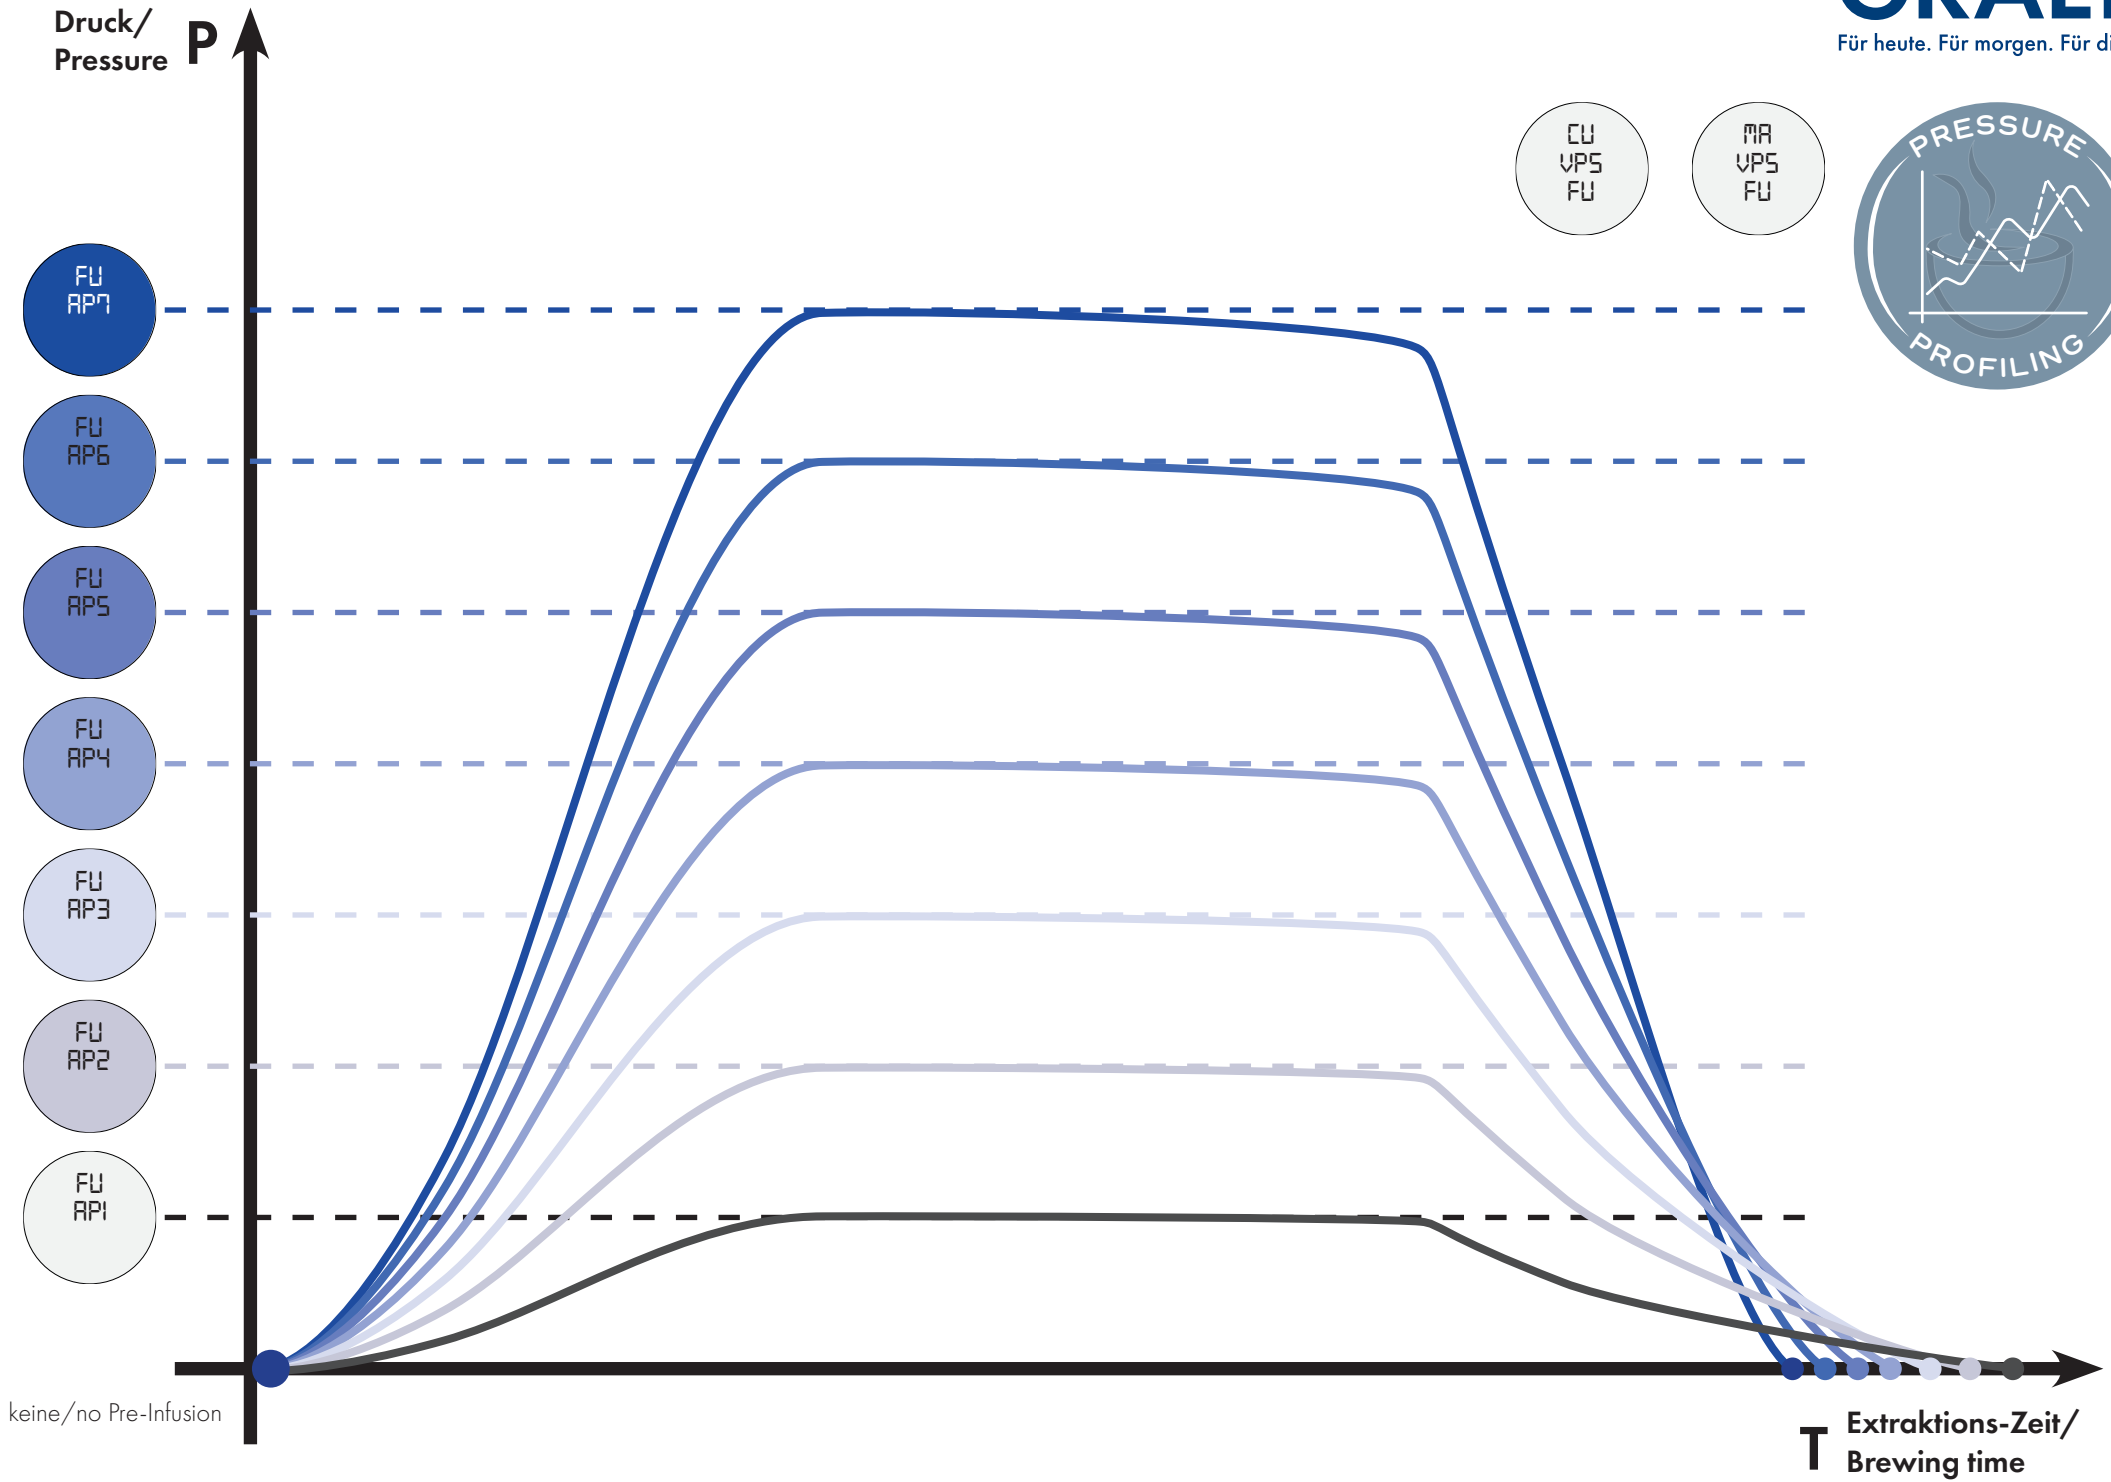



CU  
VPS  
SE

MA  
VPS  
SE

